



DIST	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET NO.	TOTAL SHEETS

REGISTERED CIVIL ENGINEER  
 Glenn DeCau  
 No. C34547  
 Exp. 9-30-13  
 CIVIL  
 STATE OF CALIFORNIA


October 19, 2012  
 PLANS APPROVAL DATE  
 THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.



**BRACE RAIL**



**STRETCHER BAR**




**TRUSS TIGHTENER**


**NOTES:**

1. All material for abutment connection to be galvanized.
2. The chain link fabric shall be replaced by barbed wire strands at 12" maximum centers between the double posts.
3. When the width of the culvert makes it necessary to anchor a post to the top of the culvert, a cast iron shoe or other device approved by the Engineer shall be used.
4. Fencing over stream and around headwall may also use Barbed Wire or Wire Mesh fencing with either wood post or steel post installation.
5. See Standard Plan A85 for Chain Link fence dimensions. See Standard Plan A86 for Barbed Wire and Wire Mesh fence dimensions and for wood post and steel post installation.


TO ACCOMPANY PLANS DATED \_\_\_\_\_

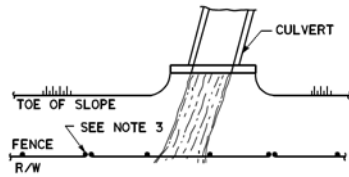

**PLAN**

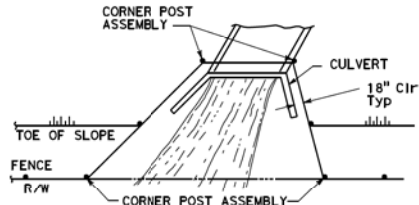


**PLAN**

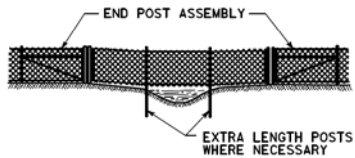

**ELEVATION**


**INSTALLATION OVER STREAM**

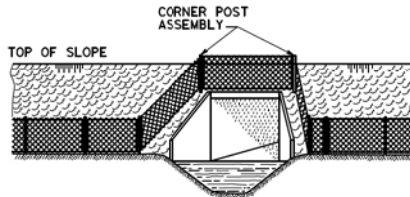


**ELEVATION**

**INSTALLATION AROUND HEADWALL**


See Note 4

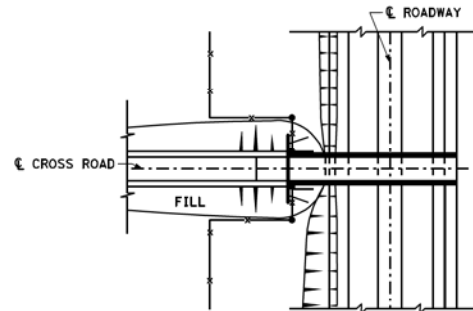

**PLAN OF ROADWAY - OVERCROSSING**

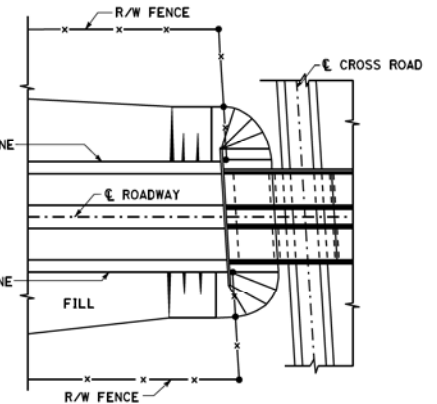

**PLAN OF ROADWAY - UNDERCROSSING**

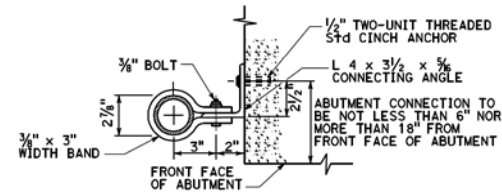

**ABUTMENT CONNECTION**

**TYPICAL INSTALLATION AT BRIDGES**

STATE OF CALIFORNIA  
 DEPARTMENT OF TRANSPORTATION  
**CHAIN LINK FENCE DETAILS**  
 NO SCALE

RSP A85B DATED OCTOBER 19, 2012 SUPERSEDES STANDARD PLAN A85B  
 DATED MAY 20, 2011 - PAGE 114 OF THE STANDARD PLANS BOOK DATED 2010.  
**REVISED STANDARD PLAN RSP A85B**

2010 REVISED STANDARD PLAN RSP A85B




DIST	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET NO.	TOTAL SHEETS

REGISTERED CIVIL ENGINEER	
October 21, 2011	
PLANS APPROVAL DATE	
THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.	

TO ACCOMPANY PLANS DATED \_\_\_\_\_

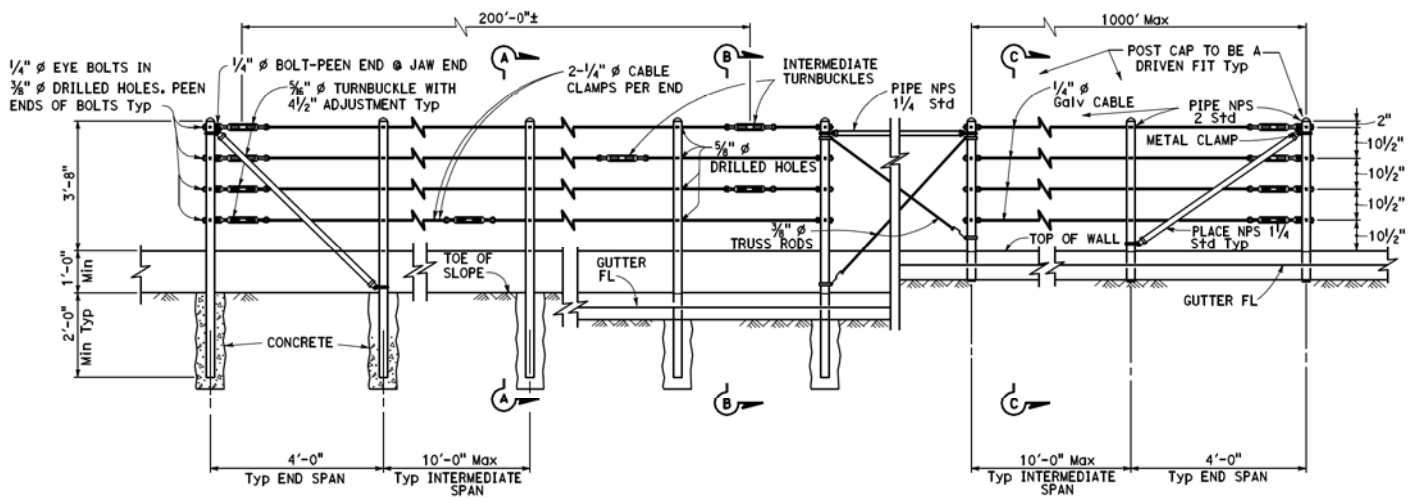


**EXISTING WALL (WITHOUT GUTTER)** Existing  
**RETAINING WALL (WITH GUTTER)** Existing  
**RETAINING WALL (WITH GUTTER)** New construction


**ELEVATION**

**NOTES:**


1. Maximum distance between turnbuckles shall be 200'-0"±.
2. Intermediate turnbuckles to be placed in adjacent spans.
3. Cable shall not be spliced between intermediate turnbuckles and end posts.
4. Posts to be vertical.
5. Alignment of holes in posts may vary to conform to slope of top of retaining wall.
6. The Contractor shall verify all dependent dimensions in the field before ordering or fabricating any material.
7. Line posts shall be braced horizontally and trussed diagonally in both directions at intervals not to exceed 1000'.
8. Post pockets to be centered in top of wall.
9. Typical end spans, braced in both directions, shall be constructed at changes in line where the angle of deflection is 15° or more.
10. Provide thimbles at all cable loops.




**SECTION A-A**  
Existing




**SECTION B-B**  
Existing




**SECTION C-C**  
New construction



**ALTERNATIVE CABLE CONNECTION**

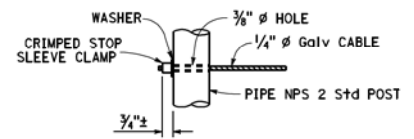

**ALTERNATIVE DEAD END ANCHORAGE**

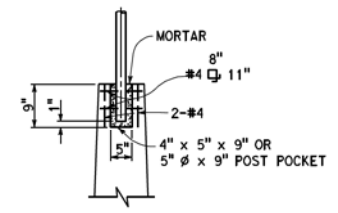

**POST POCKET**

STATE OF CALIFORNIA  
DEPARTMENT OF TRANSPORTATION  
**CABLE RAILING**

NO SCALE

RSP B11-47 DATED OCTOBER 21, 2011 SUPERSEDES STANDARD PLAN B11-47 DATED MAY 20, 2011 - PAGE 293 OF THE STANDARD PLANS BOOK DATED 2010.


**REVISED STANDARD PLAN RSP B11-47**

2010 REVISED STANDARD PLAN RSP B11-47

TO ACCOMPANY PLANS DATED \_\_\_\_\_

D16+	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET TOTAL SHEETS

October 19, 2012  
 PLANS APPROVAL DATE  
 THE STATE OF CALIFORNIA ON ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

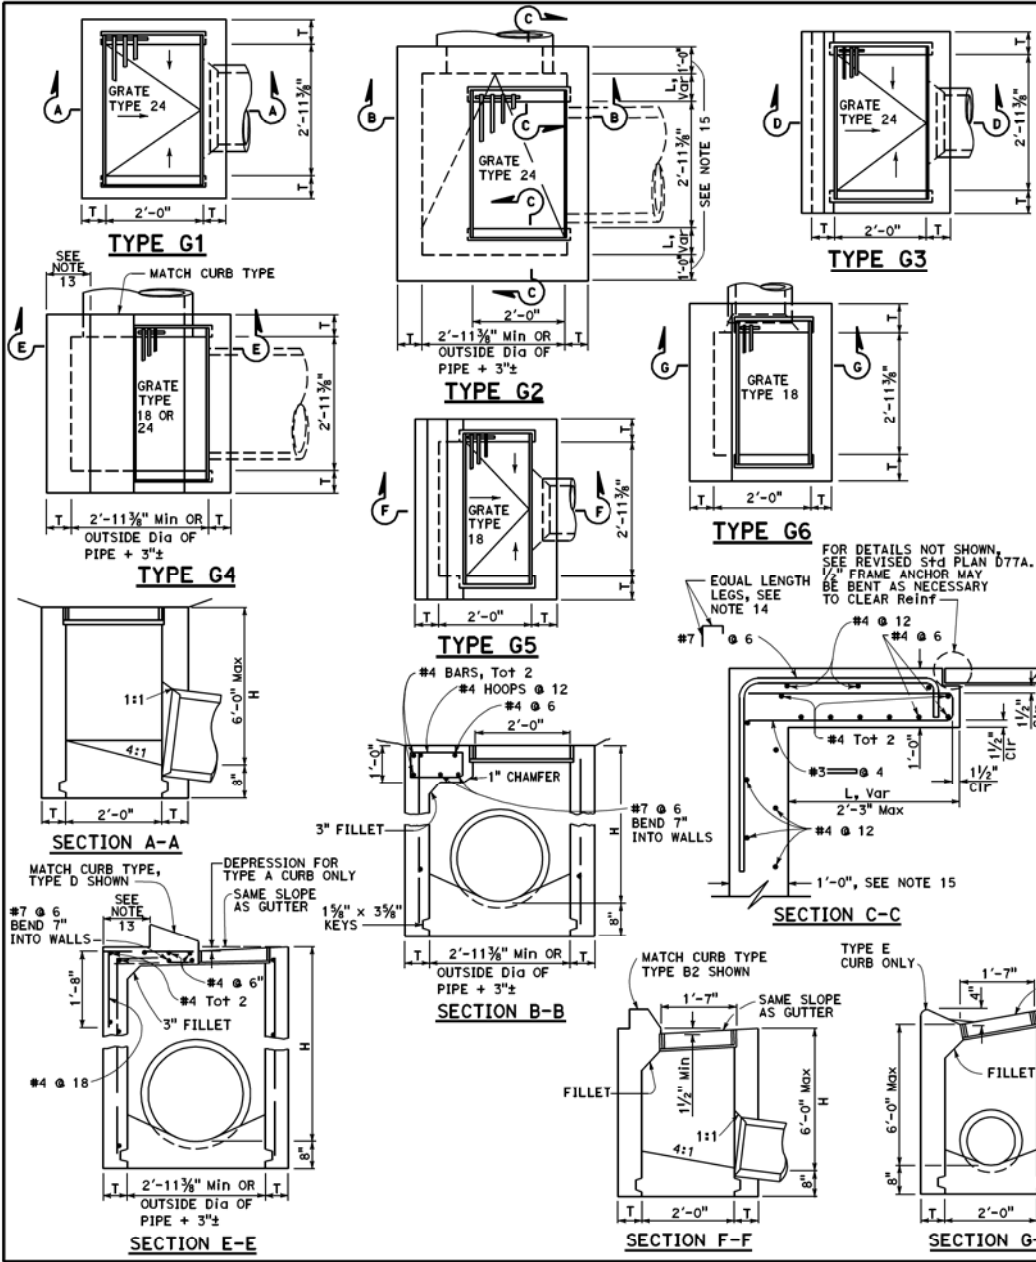

- NOTES:**
- "H" is the difference in elevation between the outlet pipe flow line and the normal gutter grade line undepressed.
  - For "T" wall thickness, see Table A below.
  - Wall reinforcing not required when "H" is 8'-0" or less and the unsupported width or length is 7'-0" or less. Walls exceeding these limits shall be reinforced with #4 bars @ 1'-6" ± centers placed 1/2" clear to inside of box unless otherwise shown.
  - Inlet bottom reinforcing not required. See Standard Plan D74C for alternative reinforced bottom and alternative half round bottom.
  - Steps-None required where "H" is less than 2'-6". Where "H" is 2'-6" or more, install steps with lowest rung 1'-0" above the floor and highest rung not more than 6" below top of Inlet. The distance between steps shall not exceed 1'-0" and shall be uniform throughout the length of the wall. Place steps in the wall without an opening. Steps inserts may be substituted for the bar steps. Step inserts shall comply with State Industrial Safety requirements. See Standard Plan D74C for step details.
  - Details shown apply to both metal and concrete pipe.
  - Pipe(s) can be placed in any wall.
  - Curb section shall match adjacent curb.
  - Basin floors shall have wood trowel finish and a minimum slope of 12:3 from all directions toward outlet pipe.
  - Set inlet so that grate bars are parallel to direction of principal surface flow.
  - See Revised Standard Plans D77A and D77B for grate and frame details and weights of miscellaneous iron and steel.
  - See Standard Plan D78A for gutter depression details.
  - This dimension will vary with different grates, curbs types, box width and wall thickness.
  - Bar may be rotated as necessary to clear opening. Where "L" is 6" or less, bar may be omitted.
  - Where "L" is 6" or less, wall thickness shall be as shown in Table A.
  - Cast-in-place inlets to be formed around all pipes/stubs intersecting the inlet, and concrete poured in one continuous operation. Precast inlets shall have mortared connections conforming to details for Type GCP Inlet shown on Standard Plan D75B. See Standard Specifications for mortar composition.

**TABLE A**

**CONCRETE QUANTITIES**

TYPE	H=3'-0" TO 8'-0" (T=6")		H=8'-1" TO 20'-0" (T=8")	
	H=3'-0" (CY)	ADDITIONAL PCC PER FOOT (CY)	H=8'-1" (CY)	ADDITIONAL PCC PER FOOT (CY)
G-1	0.95	0.220	See Note A	SEE NOTE A
G-2*	1.31	0.255	3.50	0.357
G-3	1.03	0.220	See Note A	SEE NOTE A
G-4* (TYPE 24)	1.27	0.255	3.48	0.357
G-4* (TYPE 18)	1.30	0.255	3.50	0.357
G-5	1.02	0.220	SEE NOTE A	SEE NOTE A
G-6	1.04	0.220	SEE NOTE A	SEE NOTE A


TABLE BASED ON 8" FLOOR SLAB. NO DEDUCTIONS ARE TO BE MADE TO THESE QUANTITIES BECAUSE OF PIPE OPENINGS, DIFFERENT FLOOR ALTERNATIVES OR DIFFERENT CURB TYPES. \* QUANTITIES FOR TYPE G-2 AND G-4 INLETS BASED ON THE MINIMUM INTERIOR DIMENSIONS.

**NOTE A:**  
 Maximum allowable height 6'-0".


STATE OF CALIFORNIA  
 DEPARTMENT OF TRANSPORTATION  
**DRAINAGE INLETS**  
 NO SCALE

RSP D73 DATED OCTOBER 19, 2012 SUPERSEDES STANDARD PLAN D73  
 DATED MAY 20, 2011 - PAGE 156 OF THE STANDARD PLANS BOOK DATED 2010.  
**REVISED STANDARD PLAN RSP D73**

2010 REVISED STANDARD PLAN RSP D73

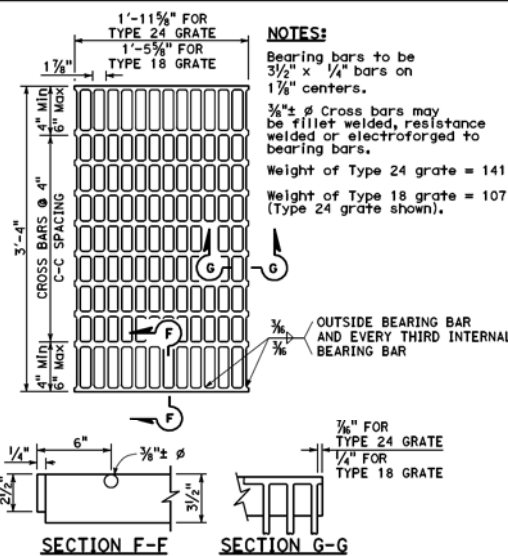


**SECTION F-F SECTION G-G**  
**TYPE 18-10 AND 24-13 GRATE**  
(Welded Steel)

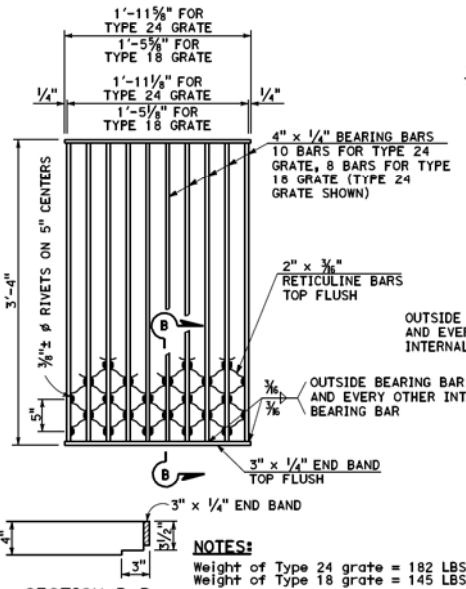


**SECTION B-B**  
**TYPE 18-8S AND 24-10S GRATE**  
(Welded Steel) Reticuline type

**NOTES:**  
Bearing bars to be 3/2" x 1/4" bars on 1 1/8" centers.  
3/8" ±  $\phi$  Cross bars may be fillet welded, resistance welded or electroforged to bearing bars.  
Weight of Type 24 grate = 141 LBS.  
Weight of Type 18 grate = 107 LBS. (Type 24 grate shown).

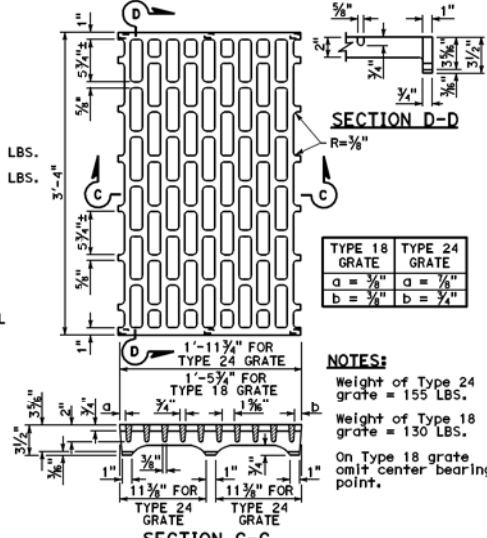


**SECTION C-C**  
**TYPE 18-8C AND 24-10C GRATE**  
(Cast ductile iron)

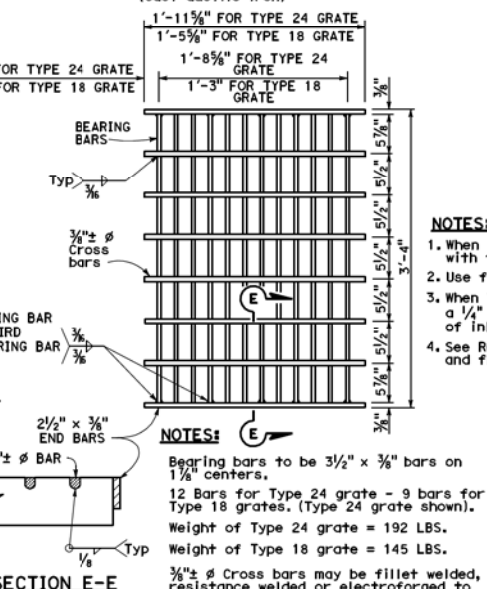


**SECTION E-E**  
**TYPE 18-9X AND 24-12X GRATE**  
(Welded Steel)

TYPE 18 GRATE	TYPE 24 GRATE
a = 3/8"	a = 7/8"
b = 3/8"	b = 1/2"

**NOTES:**  
Weight of Type 24 grate = 155 LBS.  
Weight of Type 18 grate = 130 LBS.  
On Type 18 grate omit center bearing point.

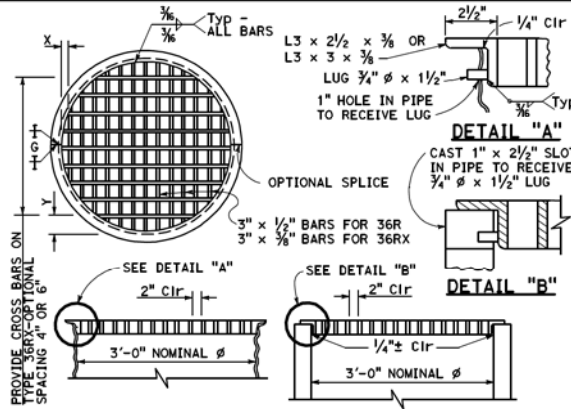

**TYPE 36R AND 36RX GRATE DETAILS**

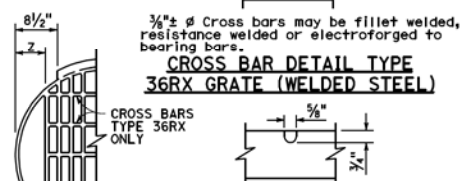

**CROSS BAR DETAIL TYPE 36RX GRATE (WELDED STEEL)**  
**CROSS BAR DETAIL ALTERNATIVE CAST DUCTILE IRON OR CAST CARBON STEEL GRATE TYPE 36RX MODIFIED TYPE 36R AND 36RX GRATE FOR ODI INLET**

- NOTES:**
- When alternative grates are allowed - Final pay based on alternative with the lesser weight.
  - Use frame shown on Standard Plan D74A, D74B or RSP D77A as appropriate.
  - When Type 24-10S, 24-12X or 24-13 grates are used with GDO Inlets, a 1/4" x 3/2" x 3'-4 1/8" steel bar shall be welded across the center of inlet frame to separate the individual grates.
  - See Revised Standard Plan RSP D77A for connecting chain to welded grate and frame. When chain is required, do not use cast ductile iron grate.

**GRATE BAR SPACING TABLE**

TYPE	NO. OF BARS	CLEAR BAR SPACING	X	Y	Z
36R	13	2"	2 1/8"	-	-
36RX (STEEL)	15	2"	3/8"	3 3/4"	5 3/4"
36RX (CAST)	13	2"	2 1/8"	3 3/4"	5 3/4"
36R Mod	12	2"	2 1/8"	-	5"
36RX Mod (STEEL)	13	2"	3/8"	3 3/4"	5 3/4"
36RX Mod (CAST)	12	2"	2 1/8"	3 3/4"	5 3/4"

RSP D77B DATED APRIL 19, 2013 SUPERSEDES RSP D77B DATED JULY 20, 2012 AND STANDARD PLAN D77B DATED MAY 20, 2011 - PAGE 165 OF THE STANDARD PLANS BOOK DATED 2010.

**REVISED STANDARD PLAN RSP D77B**


DIST	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET TOTAL SHEETS

Raymond Don Tzstoo  
REGISTERED CIVIL ENGINEER

April 19, 2013  
PLANS APPROVAL DATE

STATE OF CALIFORNIA  
THE STATE OF CALIFORNIA ON ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

Raymond Don Tzstoo  
No. C37332  
Exp. 6-30-14  
CIVIL  
REGISTERED PROFESSIONAL ENGINEER  
STATE OF CALIFORNIA

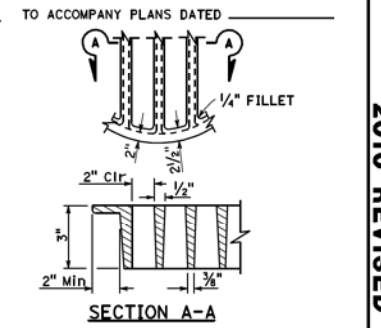

**SECTION A-A**  
**ALTERNATIVE CAST DUCTILE IRON GRATE OR CAST CARBON STEEL GRATE TYPE 36R AND 36RX**

**BASIS FOR MISC IRON AND STEEL FINAL PAY WEIGHTS FOR DRAINAGE INLETS**

INLET TYPE	GRATE TYPE	NO. OF GRATES	WEIGHT LB
GDO (SEE NOTE 4)	24-10C	2	391
	24-10S	2	456
	24-12X	2	473
	24-13	2	374
G0, G0L, G1, G2, G3, G4 (TYPE 24)	24-10C	1	202
	24-10S	1	229
	24-12X	1	239
	24-13	1	188
G4 (TYPE 18) G5, G6	18-8S	1	187
	18-9X	1	187
	18-10	1	149
GT1, GT2	18-8S	2	374
	18-9X	2	374
	18-10	2	298
GT3, GT4	24-10C	2	404
	24-10S	2	458
	24-12X	2	478
ODI	24-13	2	376
	36RX (Mod)	1	196
	36RX	1	215
GMP, GCP, GCP1	ODI	1	220
	36R	1	236
TRASH RACK			22
GRATE CHAIN			3

STATE OF CALIFORNIA  
DEPARTMENT OF TRANSPORTATION  
**GRATE DETAILS No. 2**  
NO SCALE